


**Cooling tower supply water usage before and after  
HydroStop roofing application.  
Applied in summer of 2008**

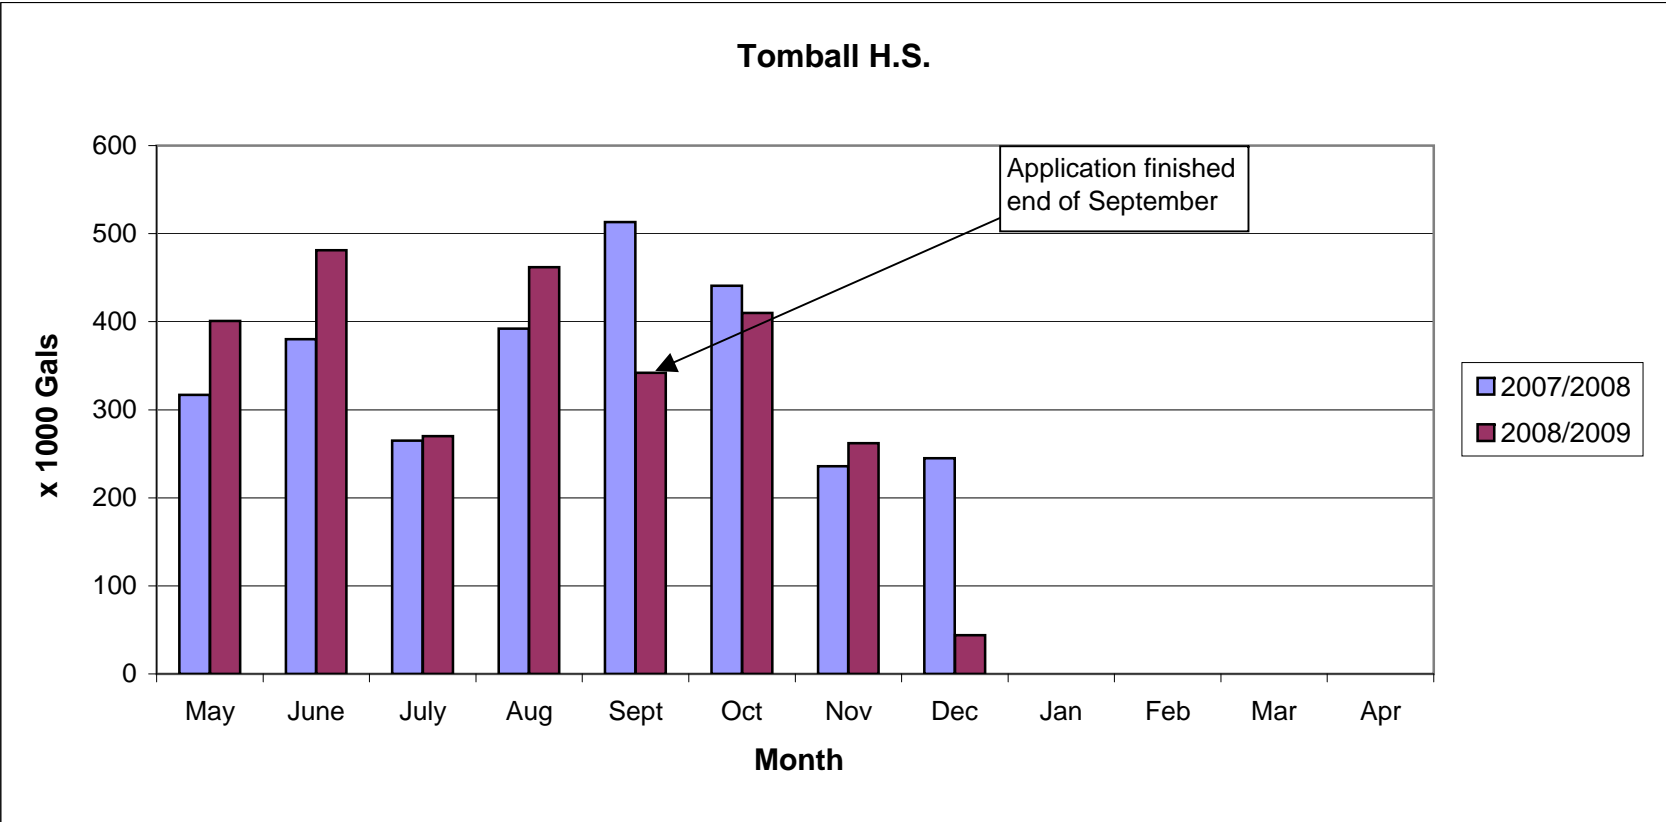

Month	Gal.	Gal.	Savings
May	2007 317	2008 401	
June	2007 380	2008 481	
July	2007 265	2008 270	
August	2007 392	2008 462	
Sept	2007 513	2008 342	\$1,618
October	2007 441	2008 410	\$293
November	2007 236	2008 262	-\$246
December	2007 245	2008 44	\$1,901
January	2008 84	2009	
February	2008 179	2009	
March	2008 122	2009	
April	2008 257	2009	
Sept to Dec.	1,435	1,058	\$3,566